



UNITS CONNECTION IN PARALLEL (NO UNITS LIMIT)

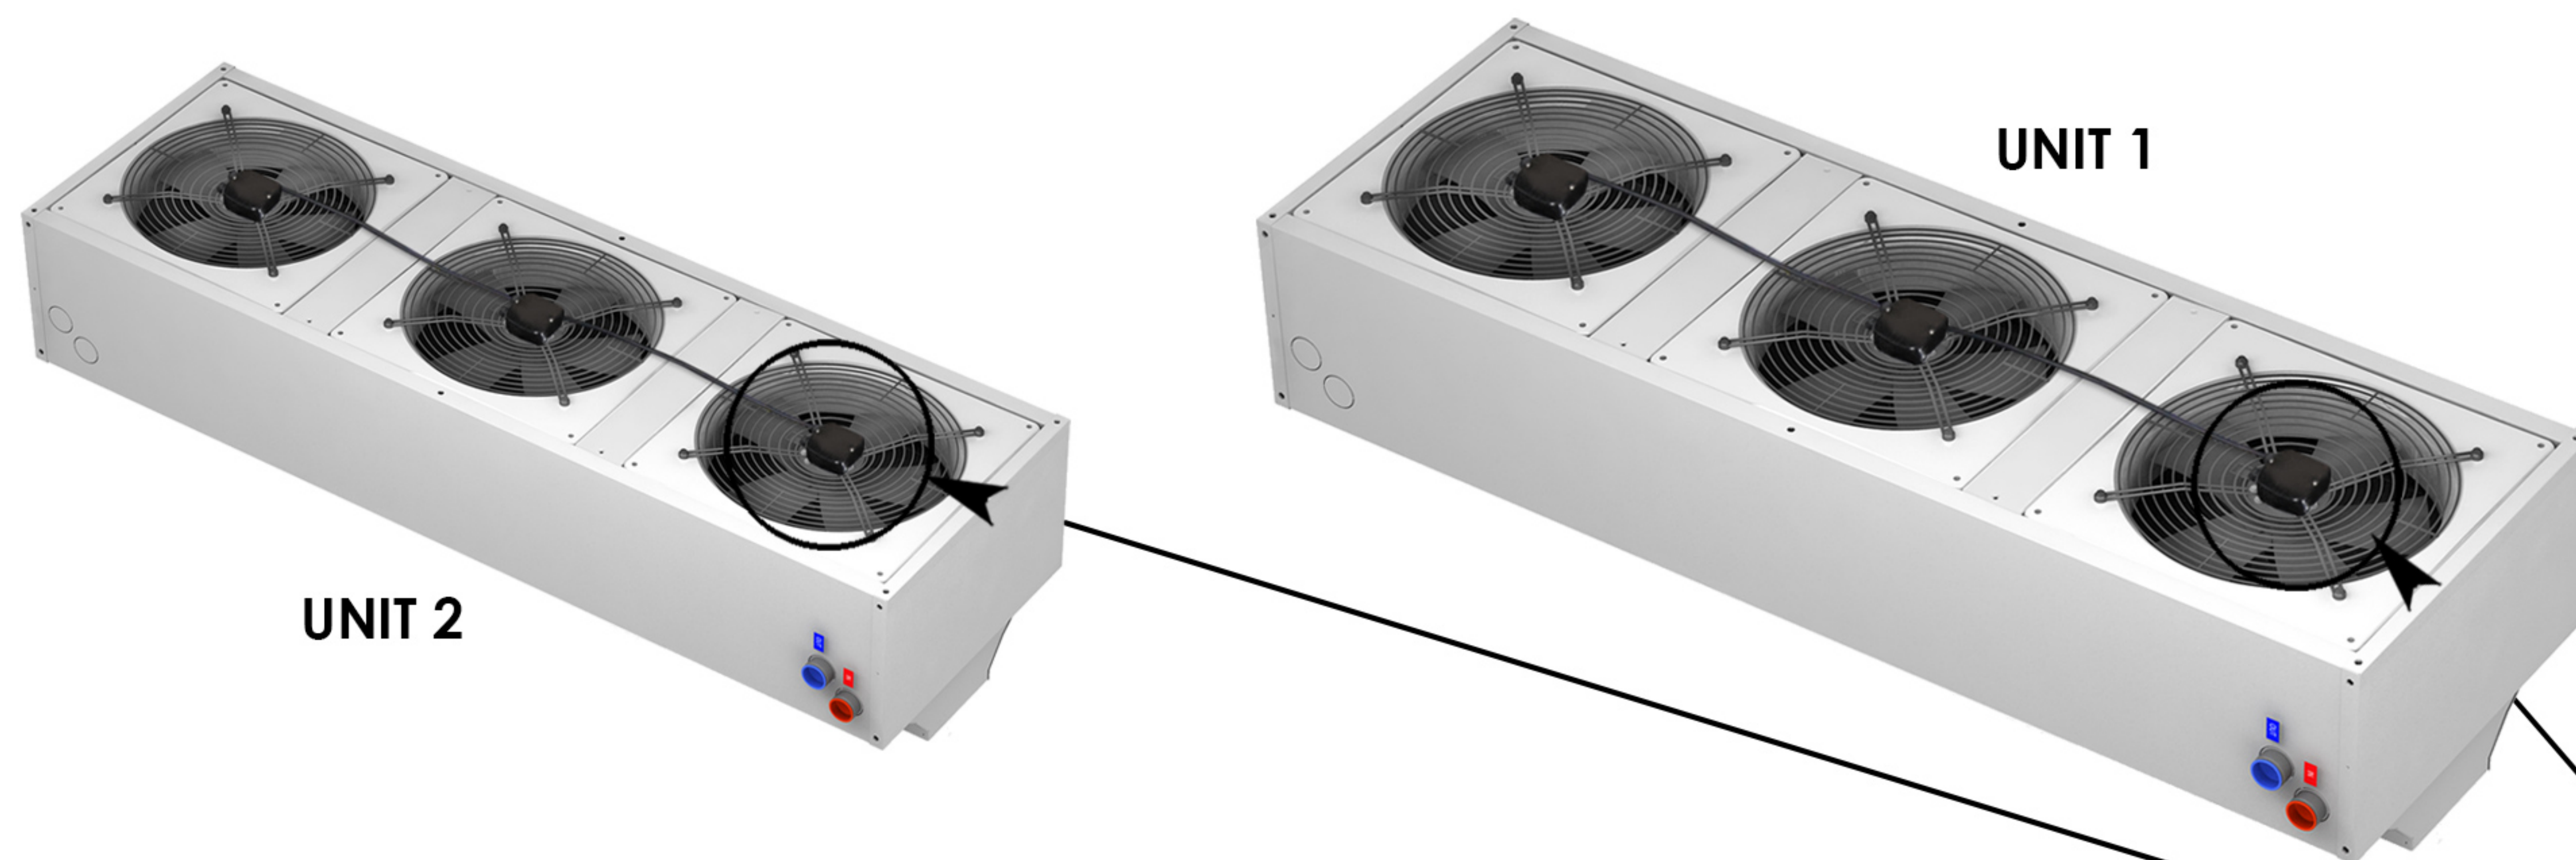

UNITS CONNECTION IN SERIAL (MAXIMUM 9 FANS)

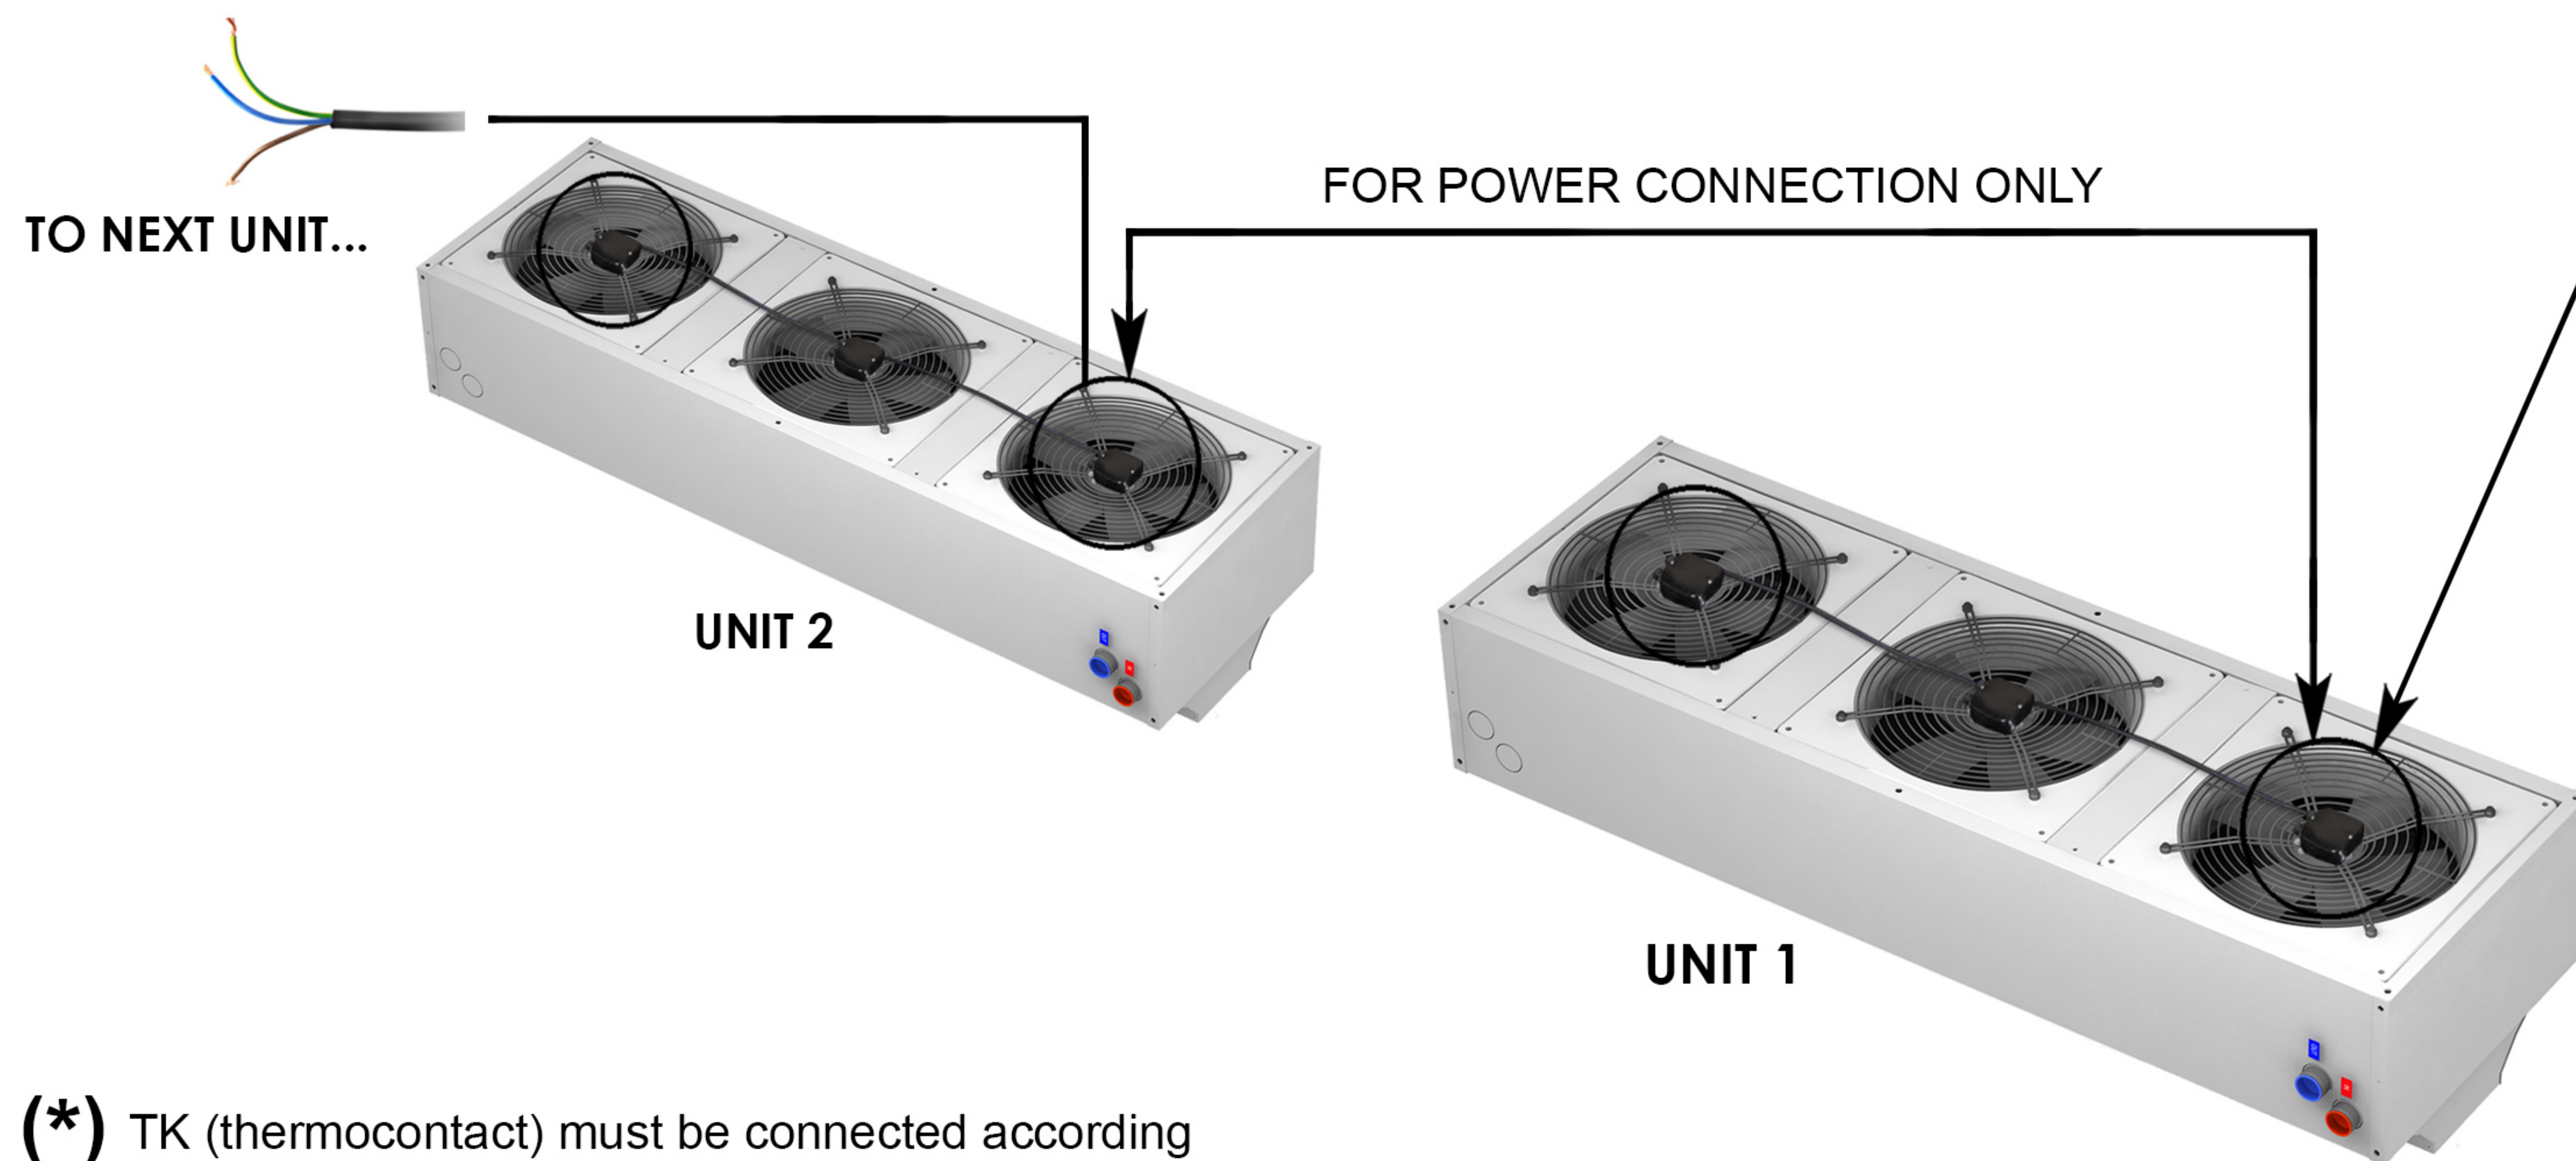


(*) TK (thermocontact) must be connected according to the wiring diagram

CONNECTION BOX


UNHEATED OR WATER HEATED

1-Open the connection box:

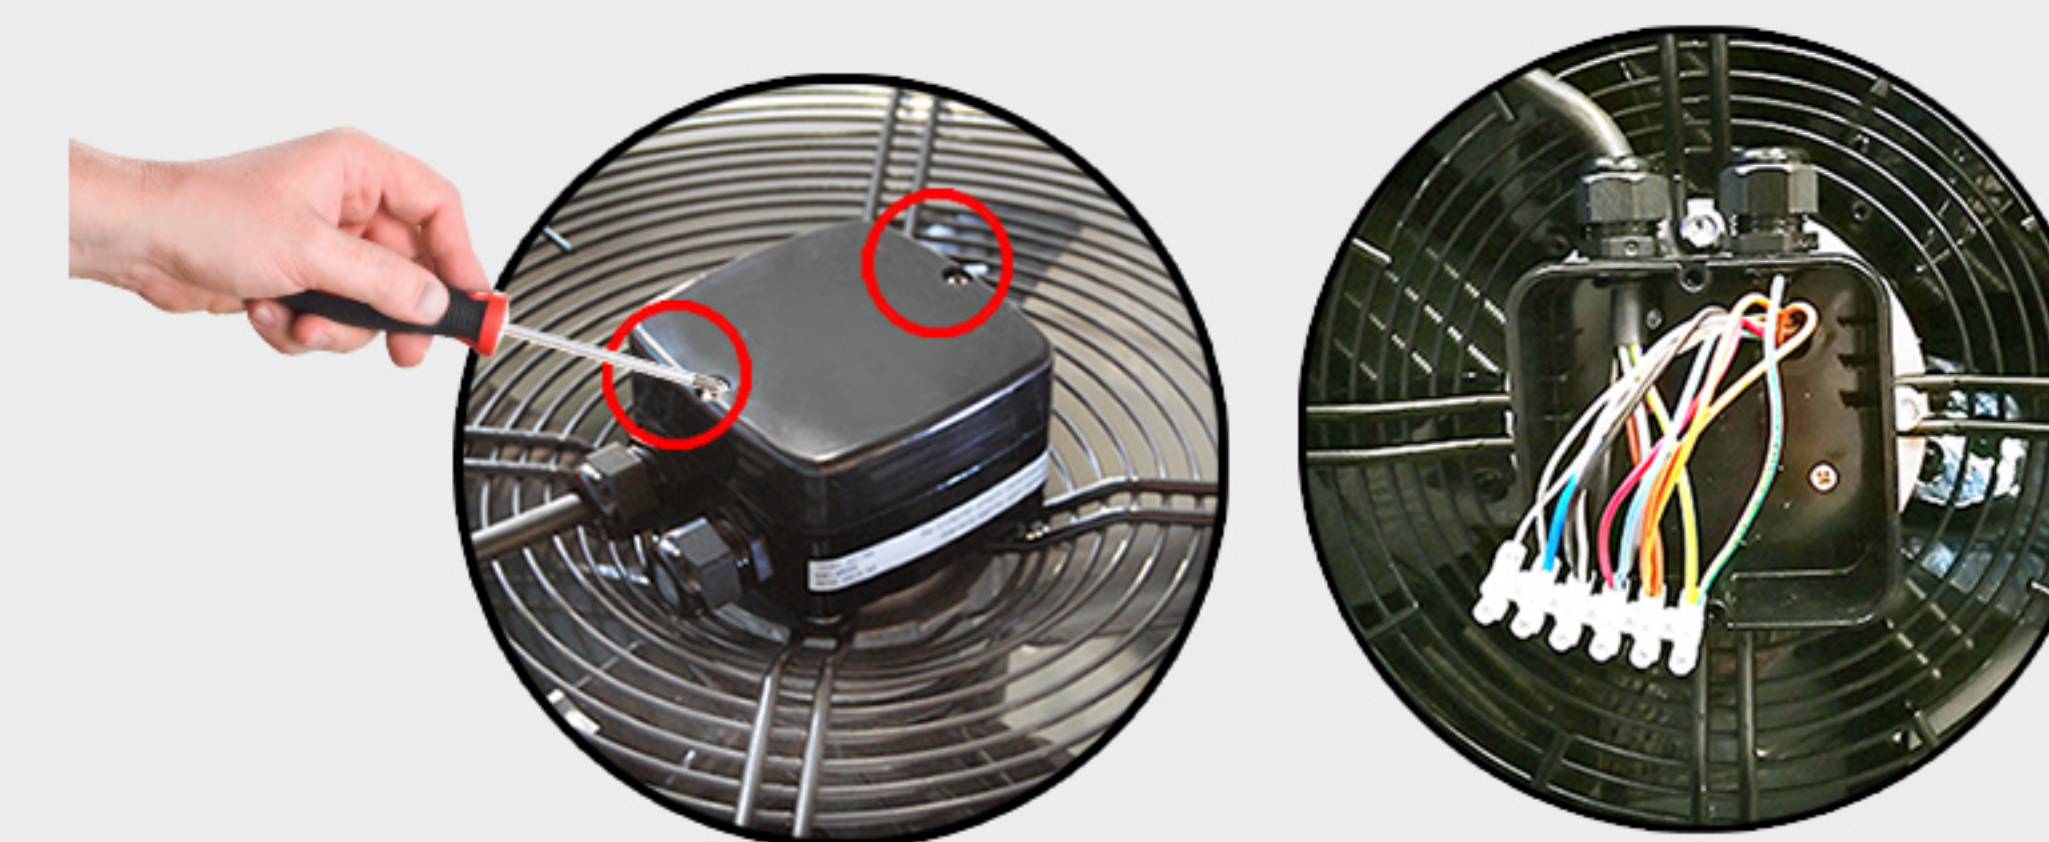

2-Connect the cables at the electrical element as the pictures show:

FIRST FAN CONNECTION BOX

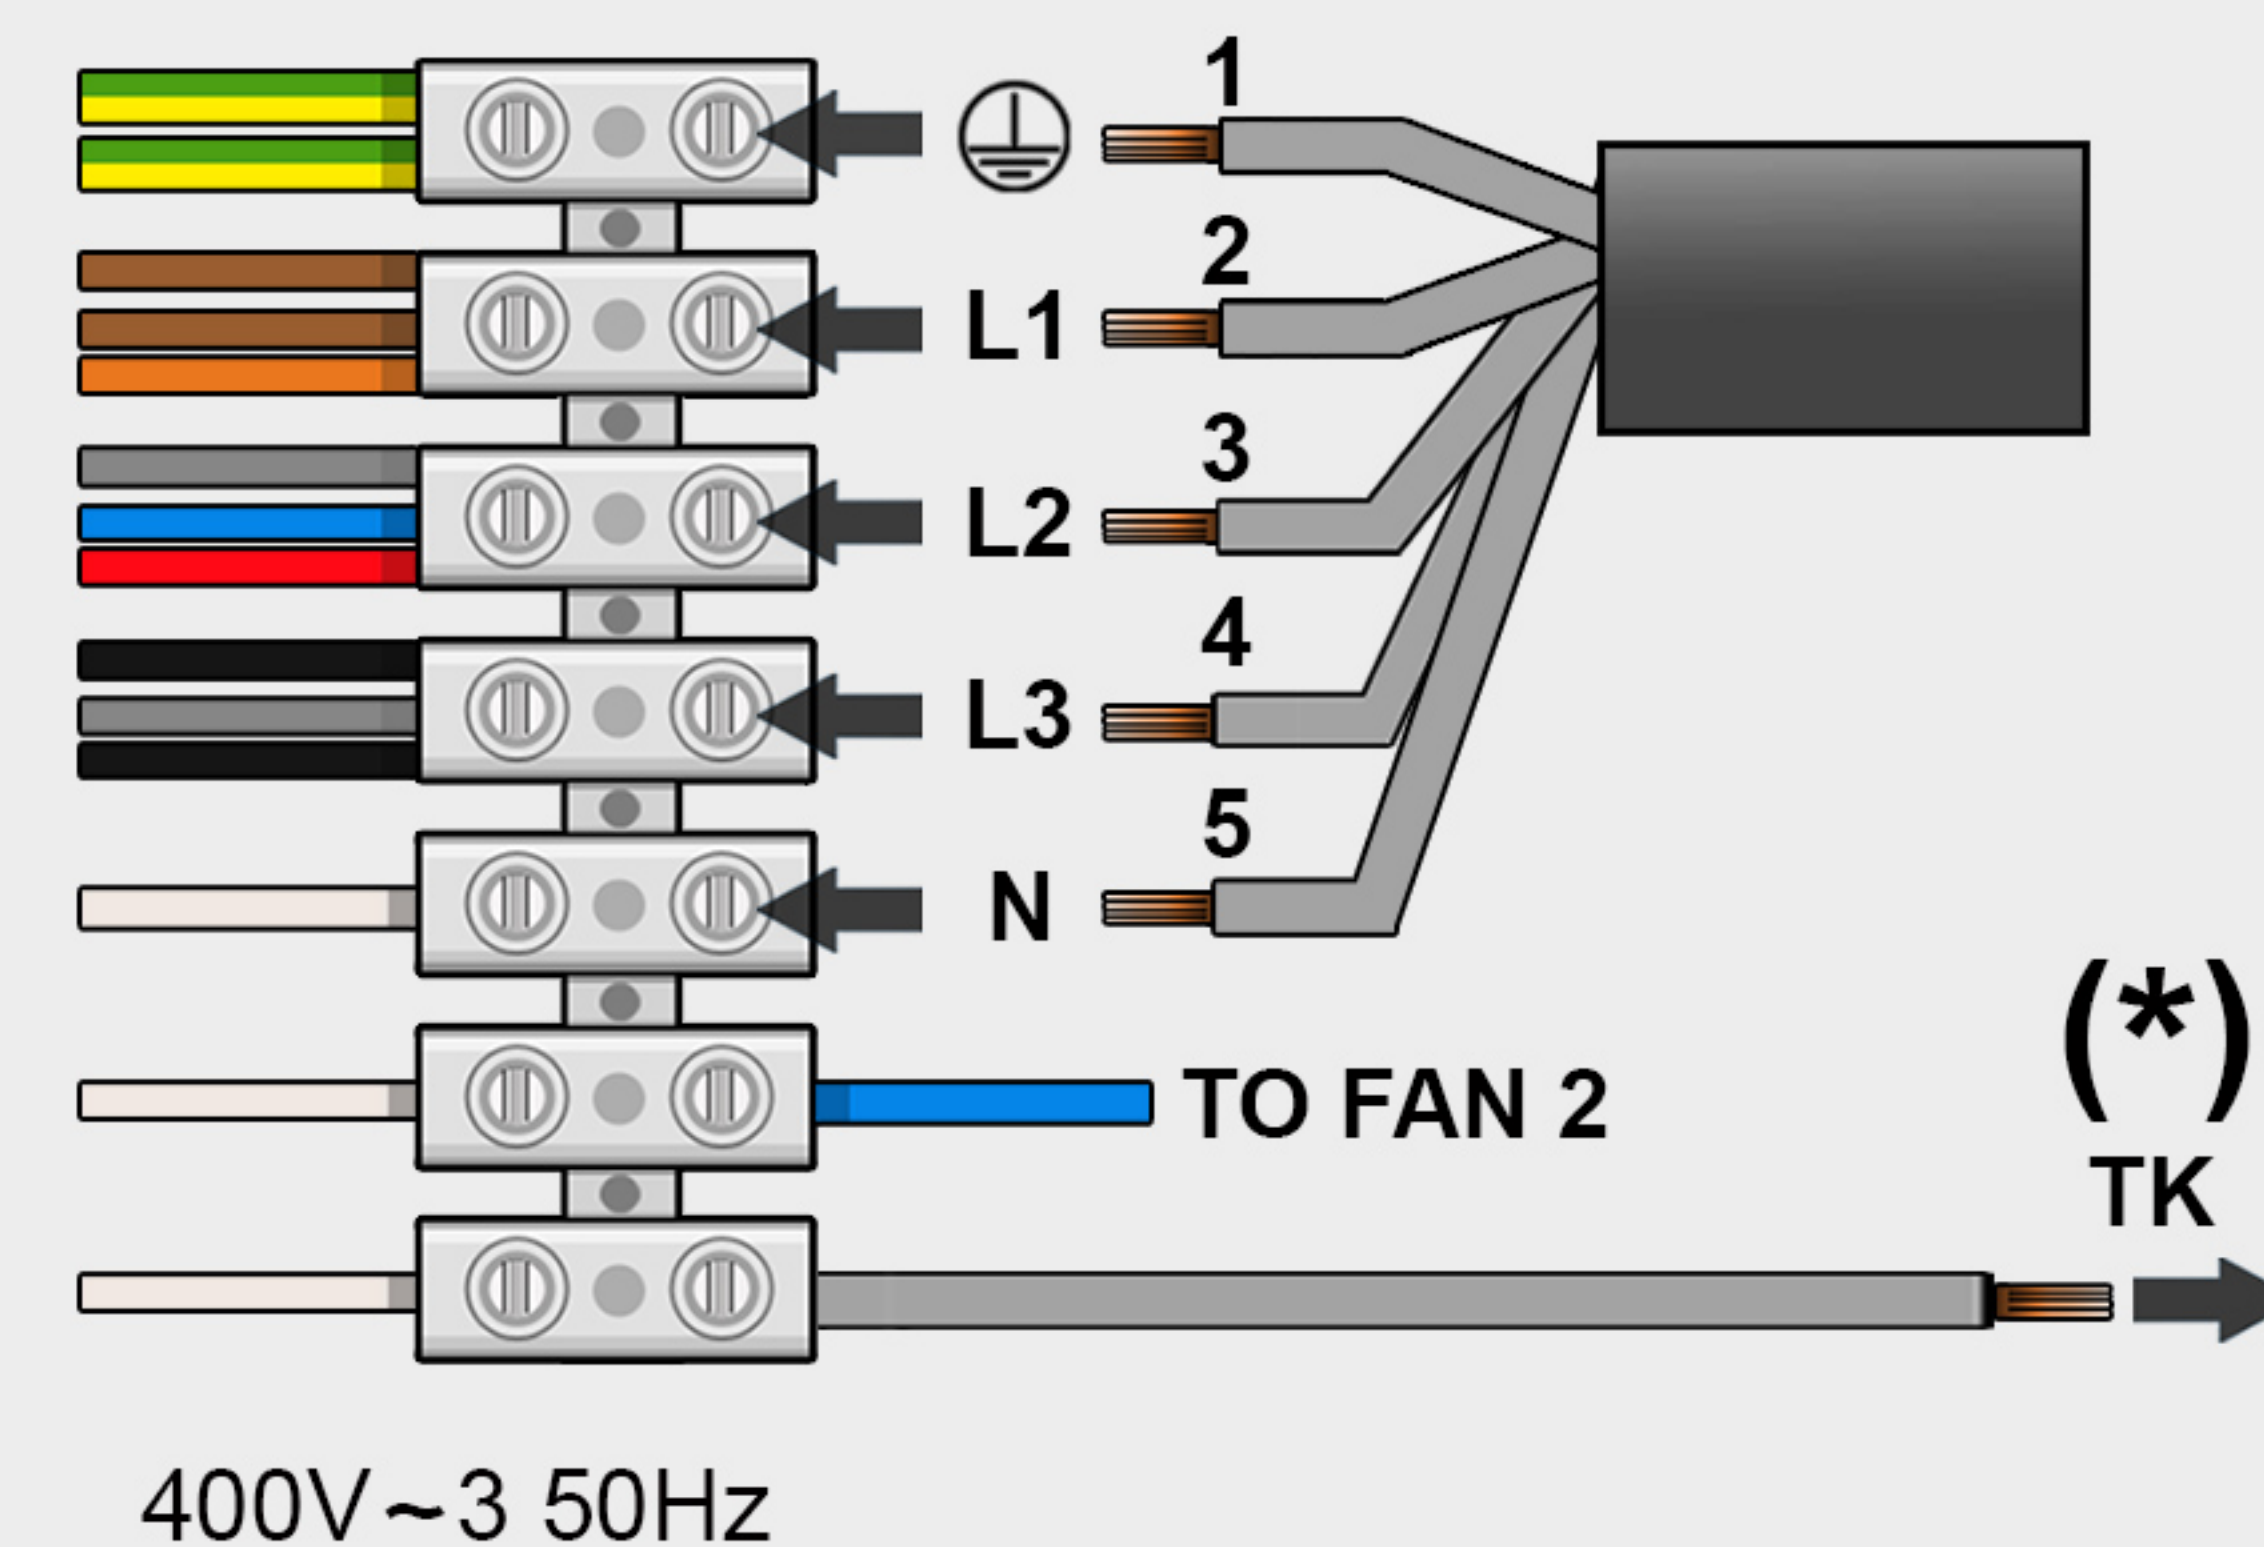

Due to the thermal contact protection, the power supply of the curtain can only be connected by the fan indicated in this diagram